


HOLENARASIPURA TALUK



FLUORIDE CONTENT IN DRINKING WATER BOREWELLS

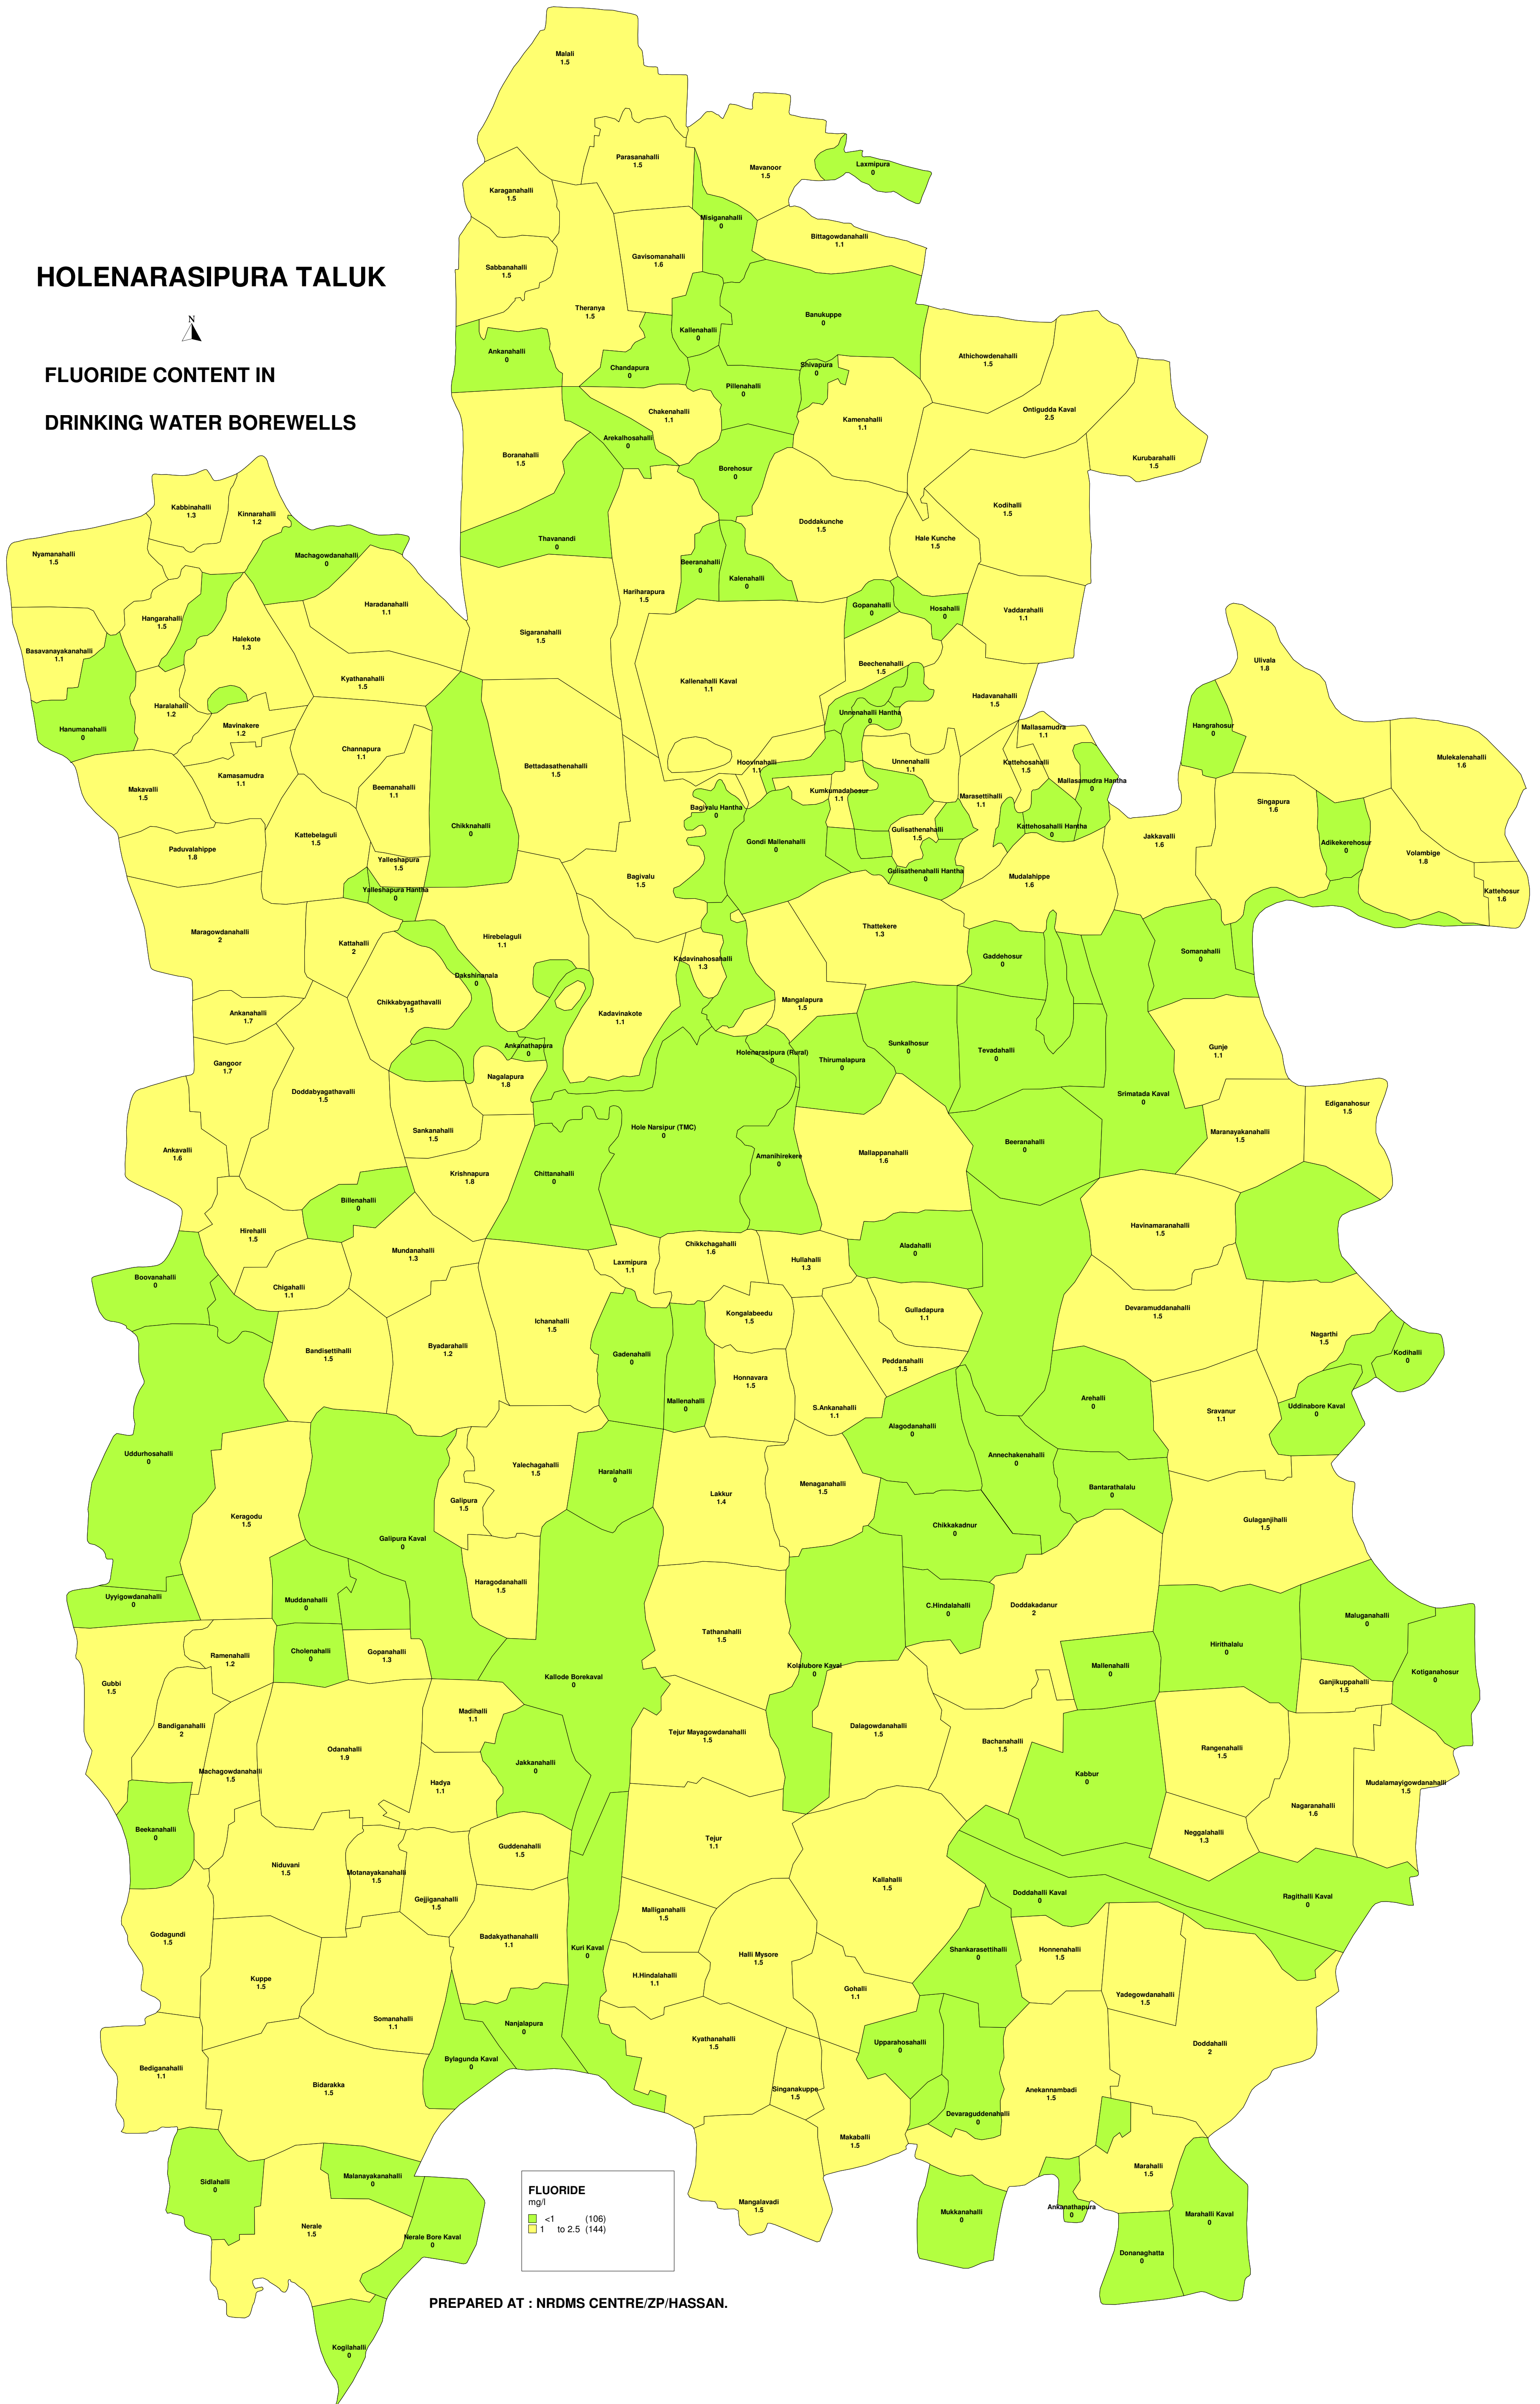

PREPARED AT : NRDMS CENTRE/ZP/HASSAN.